



Appendix B. Enforcement Process and Statistics

**Enforcement Process:**

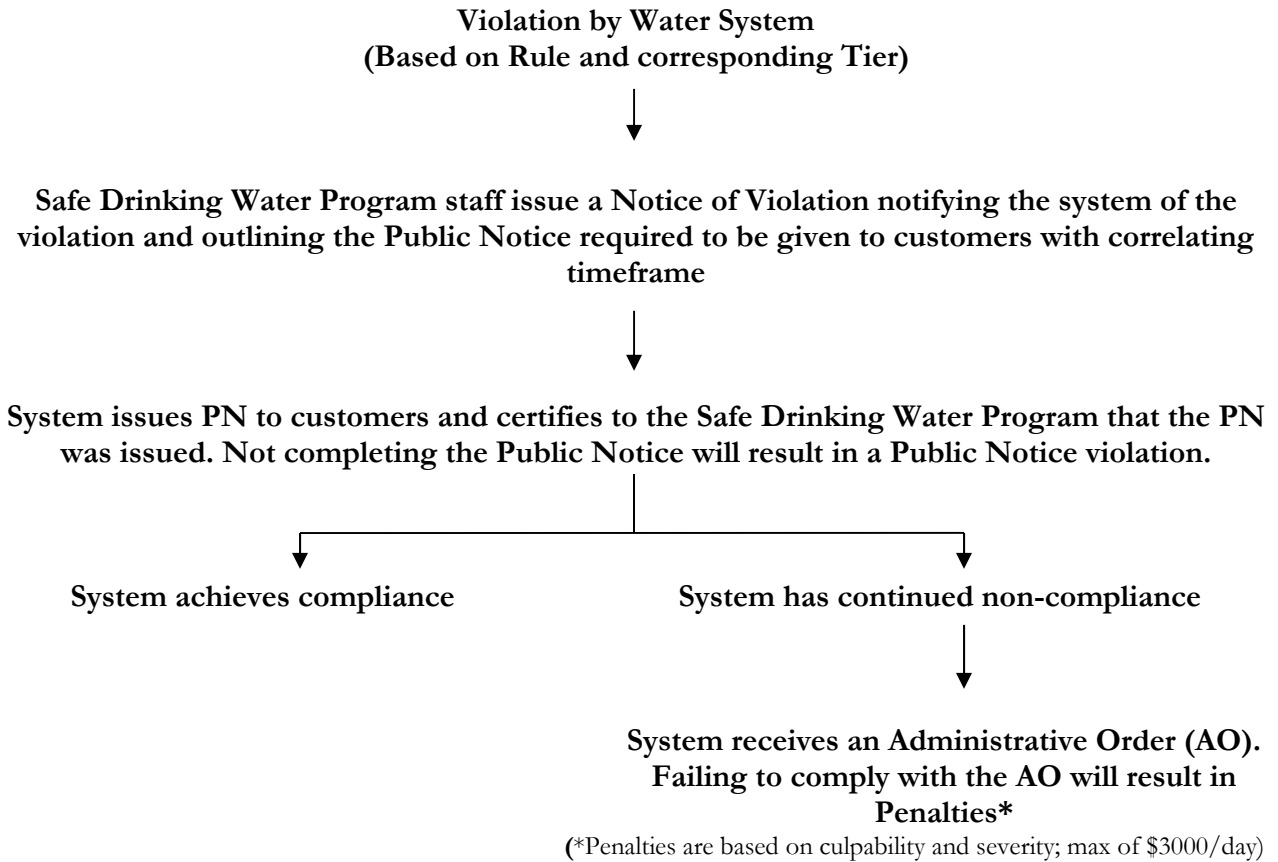


**Violation History:**

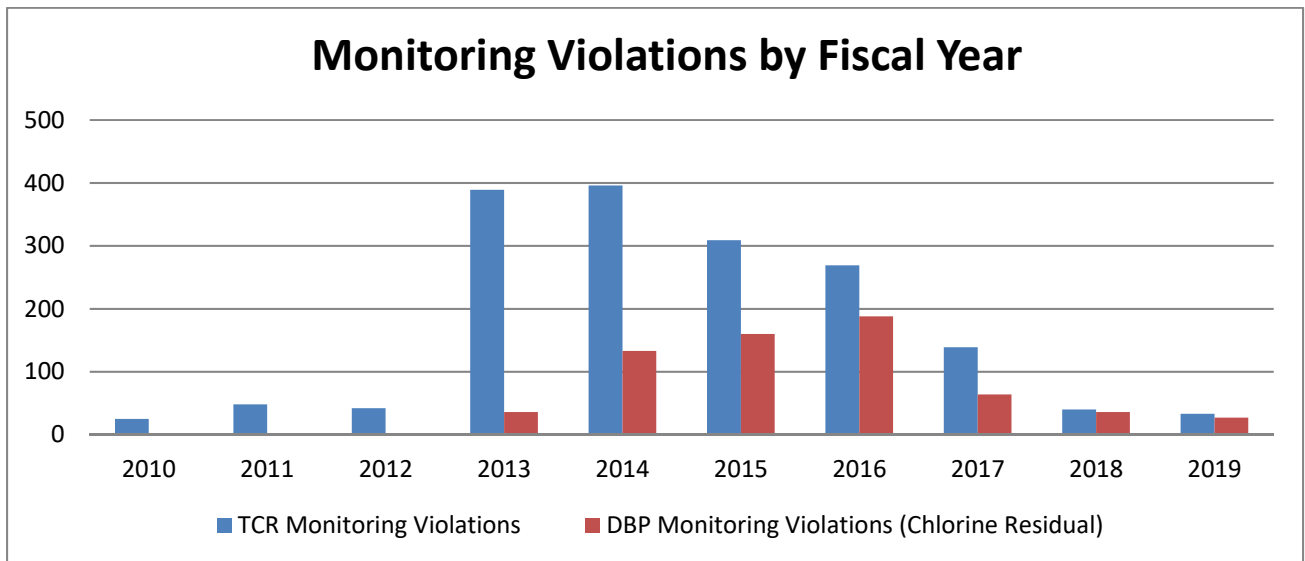

\*TCR – Total Coliform Rule (bacteriological sampling)

## Appendix B. Enforcement Process and Statistics

In 2012, LDH ceased the bacteriological sample collection program for public water systems. The graph on Page 1 shows the increase in monitoring violations. However, in 2017 LDH reinstated the sample collection program and the monitoring violations have greatly decreased along with the public notice violations.

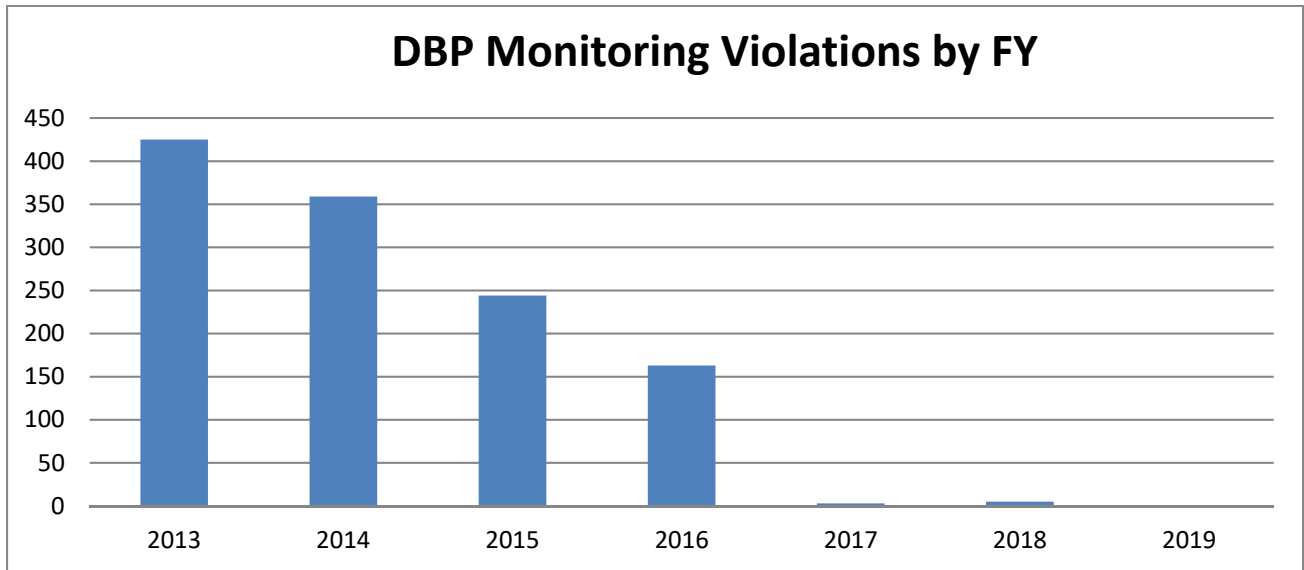

Historically, the LDH did not collect or analyze the required Disinfection Byproducts (DBP) samples (Total Trihalomethanes and Haloacetic Acids). But in January 2017, with the increased revenue from Act 605, the LDH was able to begin collecting these samples for water systems. Since that time there has been a drastic decline in monitoring violations for the Disinfection Byproducts Rule.