



State of Louisiana
Louisiana Department of Health
Office of Public Health

October 29, 2020

Mr. Mitch Downey
Superintendent of Schools
Bossier Parish School Board
P.O. Box 2000
Benton, LA 71006-2000

RE: Results of School Drinking Water Testing
Bossier Elementary School (SCH008007)
1000 Traffic Street, Bossier City, LA 71111

Dear Mr. Downey,

Act 632 of the 2018 Regular Session required the Louisiana Department of Health (LDH) to establish a pilot program for drinking water testing at 12 public elementary schools that were constructed prior to 1986 or which may otherwise be susceptible to drinking water contamination. Thank you for your participation and cooperation in this pilot program.

On October 27, 2020 a total of 38 water samples were collected from the above referenced school in accordance with guidance provided in the Environmental Protection Agency's (EPA's) - 3Ts for Reducing Lead in Drinking Water in Schools Manual. Attached are the lead and copper sample results. Please note that the sample result for sample point ID "TCR-030" is for a sample collected from the water system.

All sample results were evaluated against the state recommended action level of 0.015 mg/L for lead and 1.3 mg/L for copper for drinking water. The "first draw" sample result for sample point PF02 (kitchen pot filler, near refrigerator) exceeded the state recommended action level of 0.015 mg/L for Lead. Even though the "flush" sample result for PF02 was below the Lead action level, LDH **recommends** to replace the pot filler spray head and to flush (30 seconds) each pot filler prior to use. Also, the "after flush" sample result for sample point DF08 (Teacher's Lounge drinking fountain) exceeded the 0.015 mg/L for Lead. LDH **recommends** removing this drinking fountain from service. There were five sample points (fixtures) with a copper action level exceedance. LDH **recommends** to perform routine daily flushing at those fixtures prior to use to reduce copper levels in the drinking water.

LDH recommends that all schools follow the guidance provided in the EPA-3Ts manual to safeguard against lead in the drinking water. The EPA-3Ts manual was developed to assist schools with lead in drinking water prevention programs. This guidance is intended for use by school officials responsible for the maintenance and/or safety of school's drinking water. This document along with other helpful information is available for on EPA's website at: <https://www.epa.gov/dwreginfo/3ts-reducing-lead-drinking-water-schools-and-child-care-facilities>.

October 29, 2020

Page 2

RE: Results of School Drinking Water Testing
Bossier Elementary School (SCH008007)

Please notify this office of any control or remediation measures taken by the school. LDH will perform follow up sampling to confirm the corrective actions were effective.

Please feel free to contact me or Caryn Benjamin regarding any of the enclosed information.

Sincerely,



Amanda Ames, P.E.
Chief Engineer and Safe Drinking Water Administrator, LDH

Attachments

cc: Dr. Norcha Lacy, Principal, Bossier Elementary School

Sample Results Summary

Bossier Elementary School (SCH008007)		Lead (ug/L) AL = 15 ug/L		Copper (mg/L) AL = 1.3 mg/L	
		First Draw	After Flush	First Draw	After Flush
Tank Fountain, Rm 102	DF01	ND	ND	0.6	ND
Tank Fountain, Rm 104	DF02	ND	ND	1.8	0.2
Tank Fountain, Rm 207	DF03	ND	ND	0.8	0.1
Tank Fountain, Rm 203	DF04	ND	ND	0.8	ND
Tank Fountain, Teacher Lounge	DF05	ND	18	0.8	0.1
Tank Fountain, Cafeteria	DF06	4	1	0.5	0.1
Tank Fountain, Rm 10	DF07	ND	ND	0.4	ND
Tank Fountain, Rm 15	DF08	1	ND	0.8	0.1
Tank Fountain, 22	DF09	2	ND	0.2	ND
Tank Fountain, Gym	DF10	2	ND	0.4	0.2
Tank Fountain, Main Office, Left	DF11	ND	ND	3.3	0.3
Tank Fountain, Girls Rr, Left	DF13	ND	ND	0.8	0.2
Pot Filler, Boiler, Kitchen	PF01	ND	ND	1.9	0.2
Pot Filler, Refrigerator, Kitchen	PF02	38	4	0.7	0.2
Pot Filler, Rice Steamer, Kitchen	PF03	ND	ND	ND	ND
Sink, Rm 203	SK01	ND	ND	0.2	ND
Sink, Teacher Lounge	SK02	2	ND	3.1	0.2
2c Kitchen Sink	SK03	ND	ND	1.9	0.2
Handwash Sink, Rm 16 Hall	SK04	3	ND	0.5	0.3

"ND" - None Detect - contaminant level is below the Laboratory Report Limit (<0.001 mg/L Lead or <0.1 mg/L Copper)

"AL" - Action Level - state recommended action level



State of Louisiana
Louisiana Department of Health
Public Health Laboratories
1209 Leesville Avenue
Baton Rouge, LA 70802
225-219-5200
<http://www.dhh.la.gov/lab>



October 29, 2020

The following analytical results have been obtained for the indicated sample(s) which was submitted to this laboratory:

Sample Pt. Description:	TANK FOUNTAIN, RM 102	Sample ID:	B2005760-001
Sample Pt ID:	DF01	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:36:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.6	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, RM 104	Sample ID:	B2005760-002
Sample Pt ID:	DF02	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:38:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	1.8	mg/L	0.1	1.3	> MCL

Sample Pt. Description:	TANK FOUNTAIN, RM 207	Sample ID:	B2005760-003
Sample Pt ID:	DF03	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:40:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.8	mg/L	0.1	1.3	> 1/2 MCL

Sample Pt. Description:	TANK FOUNTAIN, RM 203	Sample ID:	B2005760-004
Sample Pt ID:	DF04	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:41:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.8	mg/L	0.1	1.3	> 1/2 MCL

Sample Pt. Description:	TANK FOUNTAIN, TEACHER LOUNGE	Sample ID:	B2005760-005
Sample Pt ID:	DF05	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:45:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.8	mg/L	0.1	1.3	> 1/2 MCL

Sample Pt. Description:	TANK FOUNTAIN, CAFETERIA	Sample ID:	B2005760-006
Sample Pt ID:	DF06	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:46:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	0.004	mg/L	0.001	0.015	
Copper	0.5	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, RM 10	Sample ID:	B2005760-007
Sample Pt ID:	DF07	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:50:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.4	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, RM 15	Sample ID:	B2005760-008
Sample Pt ID:	DF08	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:51:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	0.001	mg/L	0.001	0.015	
Copper	0.8	mg/L	0.1	1.3	> 1/2 MCL

Sample Pt. Description:	TANK FOUNTAIN, 22	Sample ID:	B2005760-009
Sample Pt ID:	DF09	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:53:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	0.002	mg/L	0.001	0.015	
Copper	0.2	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, GYM	Sample ID:	B2005760-010
Sample Pt ID:	DF10	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:58:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	0.002	mg/L	0.001	0.015	
Copper	0.4	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, MAIN OFFICE, L	Sample ID:	B2005760-011
Sample Pt ID:	DF11	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:47:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	3.3	mg/L	0.1	1.3	> MCL

Sample Pt. Description:	TANK FOUNTAIN, GIRLS RR, L	Sample ID:	B2005760-012
Sample Pt ID:	DF13	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:48:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.8	mg/L	0.1	1.3	> 1/2 MCL

Sample Pt. Description:	SINK, RM 203	Sample ID:	B2005760-013
Sample Pt ID:	SK01	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:42:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.2	mg/L	0.1	1.3	

Sample Pt. Description:	SINK, TEACHER LOUNGE	Sample ID:	B2005760-014
Sample Pt ID:	SK02	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:57:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	0.002	mg/L	0.001	0.015	
Copper	3.1	mg/L	0.1	1.3	> MCL

Sample Pt. Description:	2C KITCHEN SINK	Sample ID:	B2005760-015
Sample Pt ID:	SK03	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:36:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	1.9	mg/L	0.1	1.3	> MCL

Sample Pt. Description:	HANDWASH SINK, RM 16 HALL	Sample ID:	B2005760-016
Sample Pt ID:	SK04	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:44:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	0.003	mg/L	0.001	0.015	
Copper	0.5	mg/L	0.1	1.3	

Sample Pt. Description:	POT FILLER, BOILER, KITCHEN	Sample ID:	B2005760-017
Sample Pt ID:	PF01	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:47:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	1.9	mg/L	0.1	1.3	> MCL

Sample Pt. Description:	POT FILLER, REFRIGERATOR, KITCHEN	Sample ID:	B2005760-018
Sample Pt ID:	PF02	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:44:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	0.038	mg/L	0.001	0.015	> MCL
Copper	0.7	mg/L	0.1	1.3	> 1/2 MCL

Sample Pt. Description:	POT FILLER, RICE STEAMER, KITCHEN	Sample ID:	B2005760-019
Sample Pt ID:	PF03	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:46:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	First Draw		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	<0.1	mg/L	0.1	1.3	

Sample Pt. Description: TANK FOUNTAIN, RM 102
Sample Pt ID: DF01
 PWS ID: LA1015004
 Water System Name: CITY OF BOSSIER CITY WATER SYSTEM
 Facility ID: SCH008007
 Collection Address: After Flush

Sample ID: B2005760-020
 Sample Type: Special
 Sample Collector:
 Collection date: 10/27/2020 5:55:00AM
 Lab Submittal date: 10/28/2020 6:43:00AM

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	<0.1	mg/L	0.1	1.3	

Sample Pt. Description: TANK FOUNTAIN, RM 104
Sample Pt ID: DF02
 PWS ID: LA1015004
 Water System Name: CITY OF BOSSIER CITY WATER SYSTEM
 Facility ID: SCH008007
 Collection Address: After Flush

Sample ID: B2005760-021
 Sample Type: Special
 Sample Collector:
 Collection date: 10/27/2020 6:12:00AM
 Lab Submittal date: 10/28/2020 6:43:00AM

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.2	mg/L	0.1	1.3	

Sample Pt. Description: TANK FOUNTAIN, RM 207
Sample Pt ID: DF03
 PWS ID: LA1015004
 Water System Name: CITY OF BOSSIER CITY WATER SYSTEM
 Facility ID: SCH008007
 Collection Address: After Flush

Sample ID: B2005760-022
 Sample Type: Special
 Sample Collector:
 Collection date: 10/27/2020 6:08:00AM
 Lab Submittal date: 10/28/2020 6:43:00AM

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.1	mg/L	0.1	1.3	

Sample Pt. Description: TANK FOUNTAIN, RM 203
Sample Pt ID: DF04
 PWS ID: LA1015004
 Water System Name: CITY OF BOSSIER CITY WATER SYSTEM
 Facility ID: SCH008007
 Collection Address: After Flush

Sample ID: B2005760-023
 Sample Type: Special
 Sample Collector:
 Collection date: 10/27/2020 6:08:00AM
 Lab Submittal date: 10/28/2020 6:43:00AM

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	<0.1	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, TEACHER LOUNGE	Sample ID:	B2005760-024
Sample Pt ID:	DF05	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 6:20:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	After Flush		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	0.018	mg/L	0.001	0.015	> MCL
Copper	0.1	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, CAFETERIA	Sample ID:	B2005760-025
Sample Pt ID:	DF06	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 6:26:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	After Flush		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	0.001	mg/L	0.001	0.015	
Copper	0.1	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, RM 10	Sample ID:	B2005760-026
Sample Pt ID:	DF07	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 6:28:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	After Flush		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	<0.1	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, RM 15	Sample ID:	B2005760-027
Sample Pt ID:	DF08	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 6:28:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	After Flush		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.1	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, 22	Sample ID:	B2005760-028
Sample Pt ID:	DF09	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 6:38:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	After Flush		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	<0.1	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, GYM	Sample ID:	B2005760-029
Sample Pt ID:	DF10	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 6:22:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	After Flush		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.2	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, MAIN OFFICE, L	Sample ID:	B2005760-030
Sample Pt ID:	DF11	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 6:42:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	After Flush		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.3	mg/L	0.1	1.3	

Sample Pt. Description:	TANK FOUNTAIN, GIRLS RR, L	Sample ID:	B2005760-031
Sample Pt ID:	DF13	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 6:45:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	After Flush		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.2	mg/L	0.1	1.3	

Sample Pt. Description: SINK, RM 203 Sample ID: B2005760-032
Sample Pt ID: SK01 Sample Type: Special
PWS ID: LA1015004 Sample Collector:
Water System Name: CITY OF BOSSIER CITY WATER SYSTEM Collection date: 10/27/2020 6:43:00AM
Facility ID: SCH008007 Lab Submittal date: 10/28/2020 6:43:00AM
Collection Address: After Flush

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	<0.1	mg/L	0.1	1.3	

Sample Pt. Description: SINK, TEACHER LOUNGE Sample ID: B2005760-033
Sample Pt ID: SK02 Sample Type: Special
PWS ID: LA1015004 Sample Collector:
Water System Name: CITY OF BOSSIER CITY WATER SYSTEM Collection date: 10/27/2020 6:04:00AM
Facility ID: SCH008007 Lab Submittal date: 10/28/2020 6:43:00AM
Collection Address: After Flush

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.2	mg/L	0.1	1.3	

Sample Pt. Description: 2C KITCHEN SINK Sample ID: B2005760-034
Sample Pt ID: SK03 Sample Type: Special
PWS ID: LA1015004 Sample Collector:
Water System Name: CITY OF BOSSIER CITY WATER SYSTEM Collection date: 10/27/2020 5:37:00AM
Facility ID: SCH008007 Lab Submittal date: 10/28/2020 6:43:00AM
Collection Address: After Flush

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.2	mg/L	0.1	1.3	

Sample Pt. Description: HANDWASH SINK, RM 16 HALL Sample ID: B2005760-035
Sample Pt ID: SK04 Sample Type: Special
PWS ID: LA1015004 Sample Collector:
Water System Name: CITY OF BOSSIER CITY WATER SYSTEM Collection date: 10/27/2020 6:40:00AM
Facility ID: SCH008007 Lab Submittal date: 10/28/2020 6:43:00AM
Collection Address: After Flush

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.3	mg/L	0.1	1.3	

Sample Pt. Description:	POT FILLER, BOILER, KITCHEN	Sample ID:	B2005760-036
Sample Pt ID:	PF01	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:41:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	After Flush		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	0.2	mg/L	0.1	1.3	

Sample Pt. Description:	POT FILLER, REFRIGERATOR, KITCHEN	Sample ID:	B2005760-037
Sample Pt ID:	PF02	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:45:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	After Flush		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	0.004	mg/L	0.001	0.015	
Copper	0.2	mg/L	0.1	1.3	

Sample Pt. Description:	POT FILLER, RICE STEAMER, KITCHEN	Sample ID:	B2005760-038
Sample Pt ID:	PF03	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 5:47:00AM
Facility ID:	SCH008007	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	After Flush		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	<0.1	mg/L	0.1	1.3	

Sample Pt. Description:	600 YARBOROUGH ST.	Sample ID:	B2005760-039
Sample Pt ID:	TCR-030	Sample Type:	Special
PWS ID:	LA1015004	Sample Collector:	
Water System Name:	CITY OF BOSSIER CITY WATER SYSTEM	Collection date:	10/27/2020 7:08:00AM
Facility ID:	DS0950	Lab Submittal date:	10/28/2020 6:43:00AM
Collection Address:	Distribution System		

Component Name	Results	Units	Rep. Limit	MCL	Qualifiers
Lead and Copper (200.8)					
Lead	<0.001	mg/L	0.001	0.015	
Copper	<0.1	mg/L	0.1	1.3	

Qualifier Key

<u>Qualifier</u>	<u>Description</u>
> 1/2 MCL	Final Result > 1/2 MCL but < MCL
> MCL	Final Result Above MCL

Reviewed by: Aaron Hawkins

DF05

Elkay

Teacher's Lounge




Lead & Copper Sampling 2020: Bossier Elementary School

Boiler

PF01 & 02

Near Refrigerator

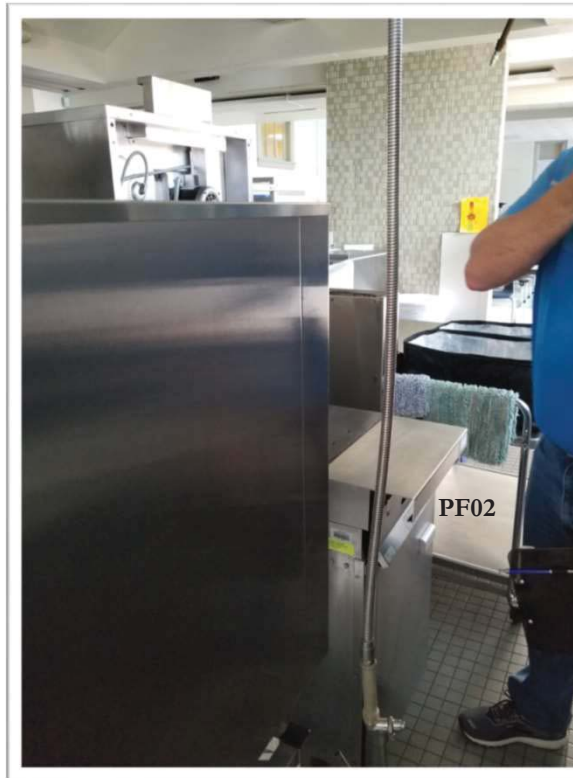

Lead & Copper Sampling 2020: Bossier Elementary School