




Refrigeration Requirements for Shellstock Harvested for Raw Consumption

Max Hrs From Harvest	36 Hrs	8 Hrs	1 Hr
Basin 02	Jan-Feb Dec	Mar-Apr Nov	May-Oct
Basin 03	Jan-Feb Dec	Mar-Apr Nov	Oct
Basin 04	Jan-Feb Dec	Mar-Apr Nov	May-Oct
Basin 06	Jan-Feb Dec	Mar-Apr Nov	May-Oct
Basin 12	Jan-Feb	Mar-Apr	May-Oct

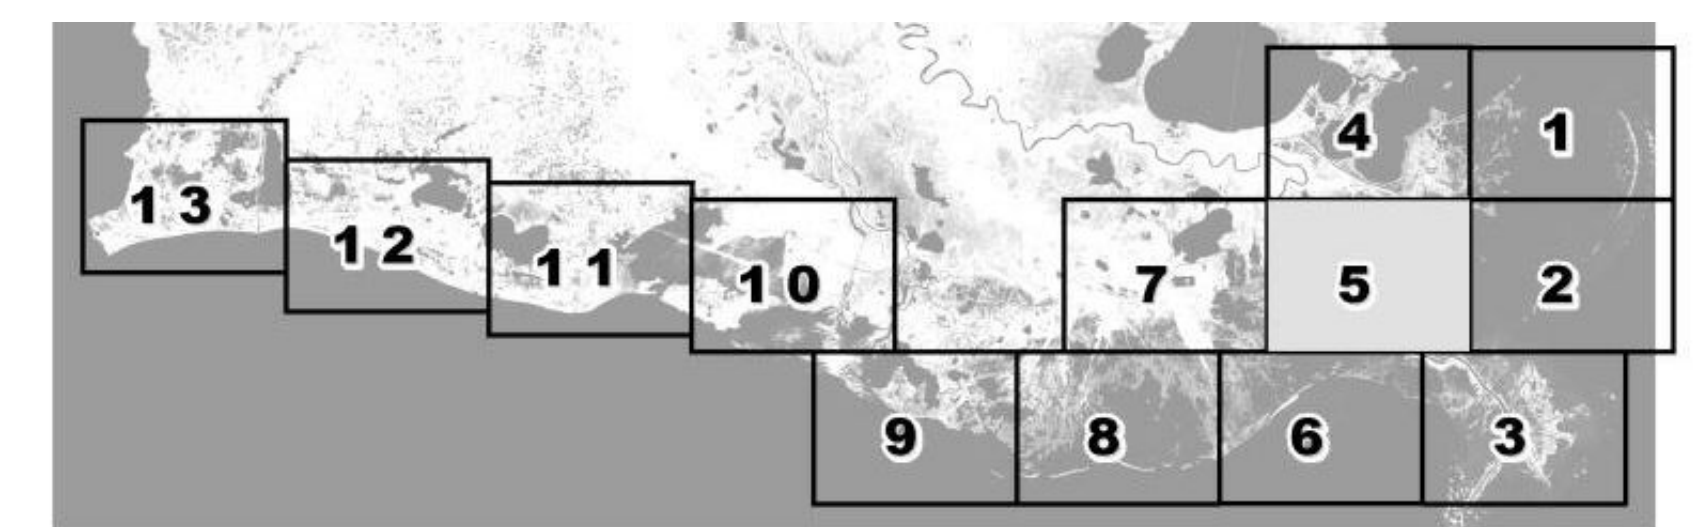

 CLOSURE LINE


 AREA LINES

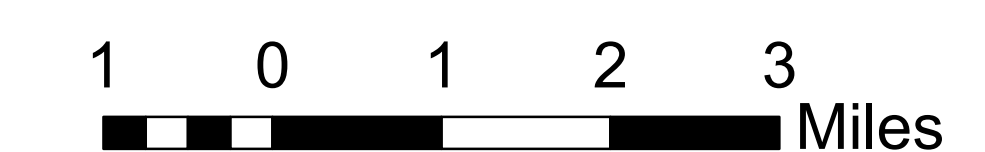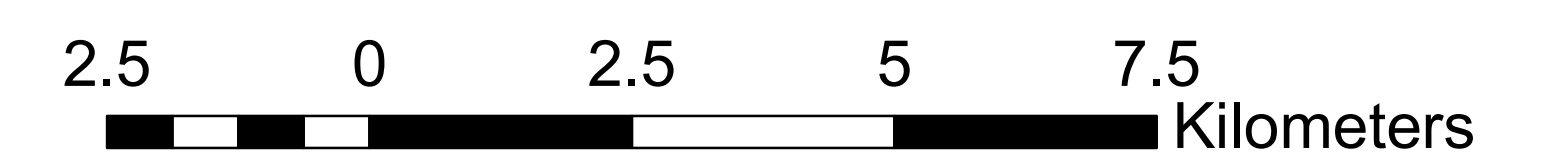

50 yard radius closure from point of waste discharge exists for all man-made habitable structures.

**Background imagery provided by USGS EarthExplorer and processed by
Quantitative Ecological Services, Inc.
Date of imagery 2014.**

Not for navigational purposes

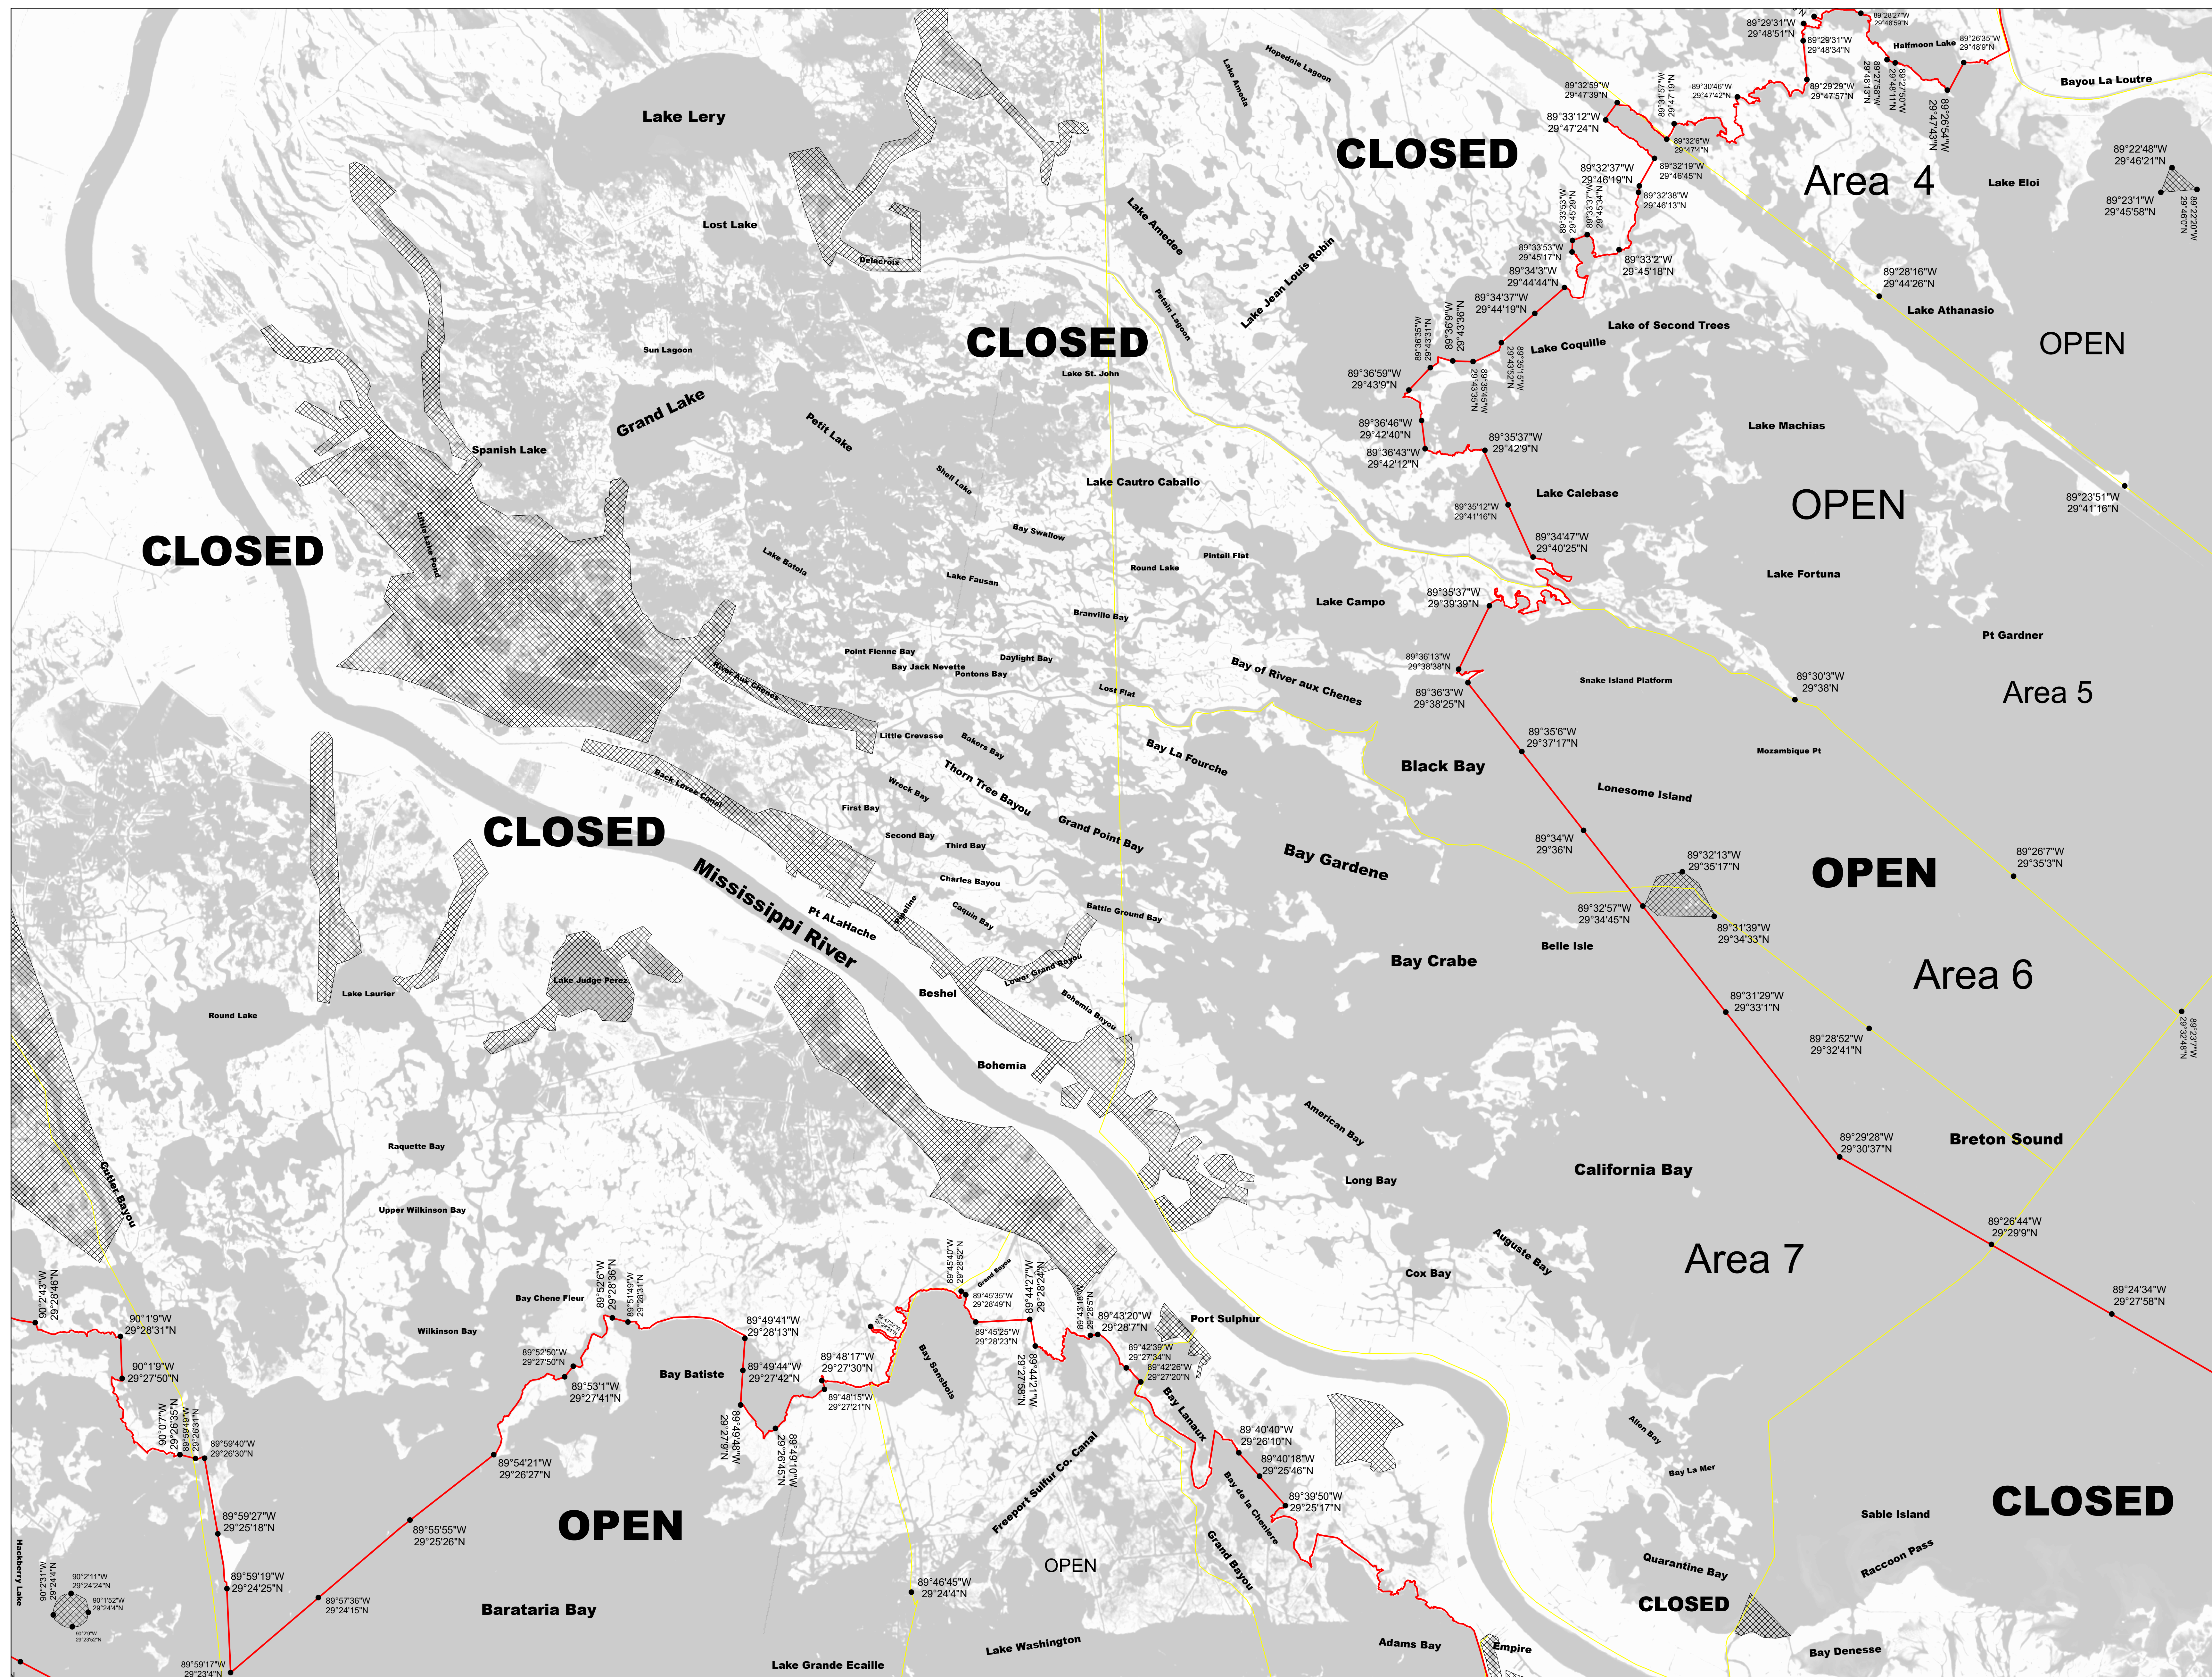

This document was printed at a cost of \$ 439.96. In this printing, 478 copies were produced. This document was produced by LDH/Office of Public Health, 628 N. 4th Street, Baton Rouge, LA 70821. It was printed in accordance with the standards for printing by State Agencies established pursuant to R.S. 43:31.

2022 MSP 11/22